




PSG 553 RAC

Flameproof, Increased Safety, Dust Protection, Restricted Breathing
Certified ATEX / IECEx / UKEX



International Approvals

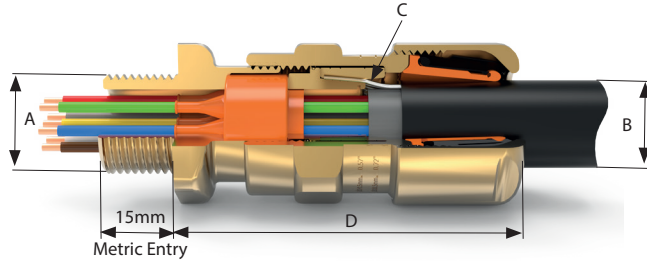

- 1 Provides an instant barrier seal around the individual cable conductors
- 2 Accommodates range of conductor diameters in a single seal
- 3 No punch tool required for seal installation
- 4 Seals around heat shrunk drain wires
- 5 Provides armour clamping using one clamping arrangement for both armour and braid types
- 6 Provides a cable retention and low smoke and fume, zero halogen seal onto the cables outer sheath
- 7 Environmentally friendly barrier solution

The PSG/553/RAC dual certified Exe/Exd cable gland offers an instant silicone barrier seal around the individual conductors of a cable. This results in unparalleled speed of installation, and instant inspection. Removes need for curing compound or resin to achieve the Exd barrier seal hence no curing time and instant gland completion.

Cable Gland Selection Table

Size Ref.	Entry Thread Size 'A'		Cable Acceptance Details											Approx Length 'D'		Hexagon Dimensions		
			Conductors				Armour / Braid / Tape 'C'				Outer Sheath 'B'							
	Metric*	NPT	Standard Seal		Alternative Seal (S)		Standard Ring		Orientation 1		Orientation 2		Min.	Max.	Across Flats	Across Corners		
			Min	Max	Min	Max	Min	Max	Min	Max	Min	Max						
Os	M16 or M20	½"	1.5	4	1	4	-	-	-	-	0.8 / 1.25	0.0 / 0.8	5.5	12	52	81	24.0	26.5
O	M16 or M20	½"	1.5	4	1	4	-	-	-	-	0.8 / 1.25	0.0 / 0.8	9.5	16	52	81	24.0	26.5
A	M20	½" or ¾"	1.5	4	1	7	-	-	-	-	0.8 / 1.25	0.0 / 0.8	12.5	20.5	53	83	30.0	32.5
B	M25	¾" or 1"	1.5	4	1	12	4.5	6.5	1	5	1.25 / 1.6	0.0 / 0.7	16.9	26.0	59.5	95	36.0	39.5
C	M32	1" or 1¼"	1.5	4	7	19	-	-	-	-	1.6 / 2.0	0.0 / 0.7	22.0	33.0	64	98	46.0	50.5

*Metric threadforms are 1.5mm pitch, 15mm long as standard

Technical Data

Material Options	Manufactured in Brass, Nickel Plated Brass or 316L Stainless Steel
Ingress Protection	IP66, IP67 and IP68 (30 metres for 7 days, special instructions apply) to IEC/EN 60529 and NEMA 4X
Enclosure Protection	IK10 to IEC 62262
Deluge Protection	to DTS01
Operating Temperature	-60°C to +100°C
Applications	Suitable for use in Zone 1, Zone 21, Zone 2 and Zone 22
Approvals	
Protection Class	Ex II 2GD Ex db IIC Gb; Ex eb IIC Gb; Ex nR IIC Gc; Ex tb IIIC Db
ATEX Certificate No	CML 19ATEX1167X CML 19ATEX4507X (Ex nR)
IECEx Certificate No	CML 19.0045X CML 21.0012X (Ex nR)
UKEX Certificate No	CML 21UKEX1161X CML 21UKEX4133X (Ex nR)
Construction & Test Standards	IEC/EN 62444 (Anchorage Type D), IEC/EN 60079-0, 1, 7, 15, 31
Marine Approvals	ABS: 19-LD1876514-1-PDA BV: 43523/B0 DNV: TAE0000BS
Additional Certifications	EAC: No EA3C RU C-GB.HA91.B.00264/21 EQM: 20-11-27224/Q20-11-000979/NB0007 Inmetro: IEx 14.0272X PESO: P450038 SONCAP: LCOGB049552-0500

Ordering Information

Format for ordering is as follows: For Alternative Seal (S), Alternative Ring (AR), add suffix S and/or AR to ordering information

Cable Gland Type	Size	Thread	Material	Optional
PSG/553/RAC	C	M32	Brass	AR
PSG/553/RAC	B	1" NPT	Brass	S

Order Example: PSG/553/RAC C M32 Brass

Alternative Reversible Armour Clamping Ring Size Selection

Size Ref	Orientation 1	Orientation 2
B	0.9 - 1.25	0.5 - 0.9
C	1.2 - 1.6	0.6 - 1.2

Cable Gland Tightening Guide

Whilst Hawke International goes to great lengths to ensure products are designed to be as simple to install, inspect and maintain as is possible, differing levels of competency, training and understanding can lead to glands being incorrectly installed. With hazardous area products, any poor installation issues can not only lead to expensive equipment failure, but also potential explosion risks and associated risk to life.

To help address issues with the overtightening of cable glands and the resultant damage to cables and seals, Hawke International has developed the patented **INBUILT TIGHTENING GUIDE**.

Without the need for fiddly measuring systems, the guide provides a permanent visual indication of the gland tightness through installation, inspection and maintenance.

How it works

The gland is permanently marked with various lines/numbers indicating the correct tightening level related to the cable diameter. Following the relevant cable gland Installation Instructions, the back seal should be tightened until a seal is formed on the cable outer sheath and then tightened one further turn.



Follow cable gland installation instructions until final stage – tightening of rear seal



Tighten backnut until a seal is formed onto the cable, then tighten one further turn



The backnut should be level with the marking guide corresponding to its diameter – this can be visually inspected and adjusted as necessary

BIBUS[®]
SUPPORTING YOUR SUCCESS

BIBUS SK, s.r.o
Trnavská 31, SK-94 901 Nitra

Tel.: 037/ 7777 911 Email: sale@bibus.sk
Fax.: 037/ 7777 999 http://www.bibus.sk